

Rubini Suspended Pendant Installation

220-240V / 50-60Hz

IP40




Terminal Labelling:

Power	
L / 1	Switched Live
E /	Earth
N	Neutral
Emergency	
L2 / 2	Unswitched Live
DA/AT3	DALI Autotest
DA/AT3	DALI Autotest
Dimming	
-/D1/DA	Analogue/DSI/DALI
+/D2/DA	Analogue/DSI/DALI
SD	Switch Dim / Corridor Function


WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

1.

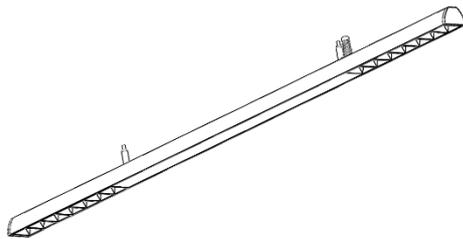


Fitting will arrive fully assembled with a flying lead apart from the two larger length versions (3112mm & 4232mm), these will arrive in two halves.

2. 3112mm & 4232mm lengths only – for shorter lengths skip to step 5.

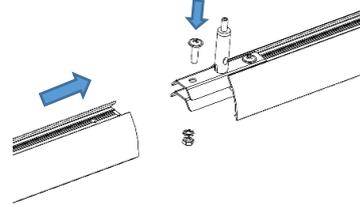


Join the 2 halves together and fix in place using the nut and bolt provided.

3.

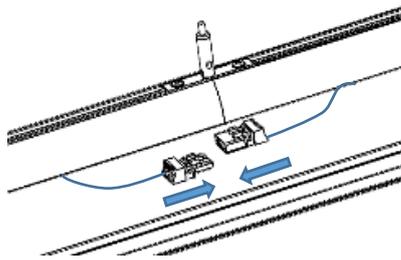


Electrically connect the 2 halves using the plug and socket and tuck inside of

4.

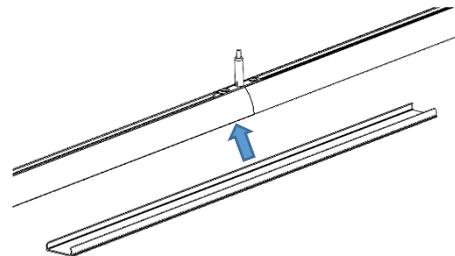


Push blanking cover into the extrusion to complete the fitting.

5.



Fix the suspension points to the ceiling at the specified centres.

6.

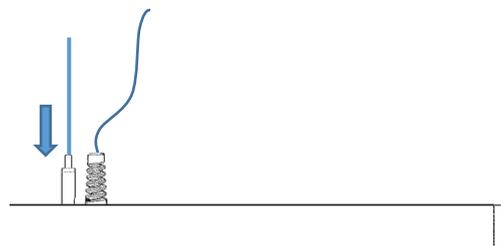

Pass suspension wire through the clutch on the back of the fittings and adjust to the required height. Connect the flying lead to the power supply.

Rubini Suspended Pendant Installation

Maintenance

- 1 Disconnect luminaire before undertaking any maintenance or cleaning.
- 2 Cleaning should be undertaken on external parts of the luminaire only using a slightly damp lint free cloth.
- 3 To remove endcap use a pan pozi screwdriver to remove screws.
- 4 Remove baffle to reveal lens.
- 5 Use a pan pozi screwdriver to remove lens from LED circuit.
- 6 Remove centre cover from fitting to reveal gear tray.
- 7 Use a pan pozi screwdriver to remove components.
- 8 Please contact Dextra for assistance with spare component supply.

