

OPUS Sconce RGBW Installation Guide

220-240V / 50-60Hz

IP65 IK08

Terminal Labelling:

Power

L1 Switched Live
E Earth
N Neutral


DMX

L1 GRN
D- DMX D-
D+ DMX D+
PI DMX PI
N2 DMX PO




WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

1. Mounting Plate Dimensions

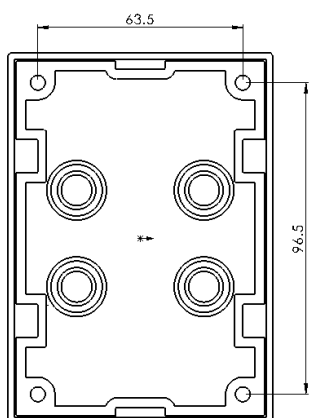


2.

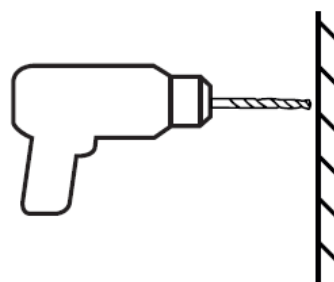


Drill hole in to the wall to make path for cable.

3. Wall mounting

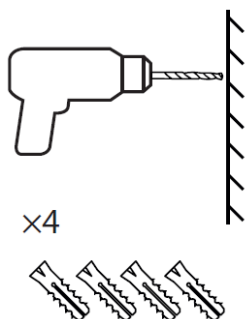


Drill four holes in to the wall according to the mounting plate dimensions and insert wall plugs.

4.

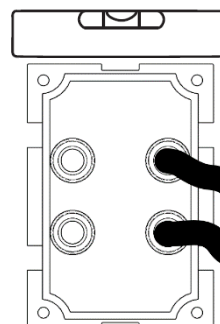


Screw the mounting plate to the wall, using a spirit level to ensure the top edge is horizontal. Make sure to thread flexes through the gromets.

5.

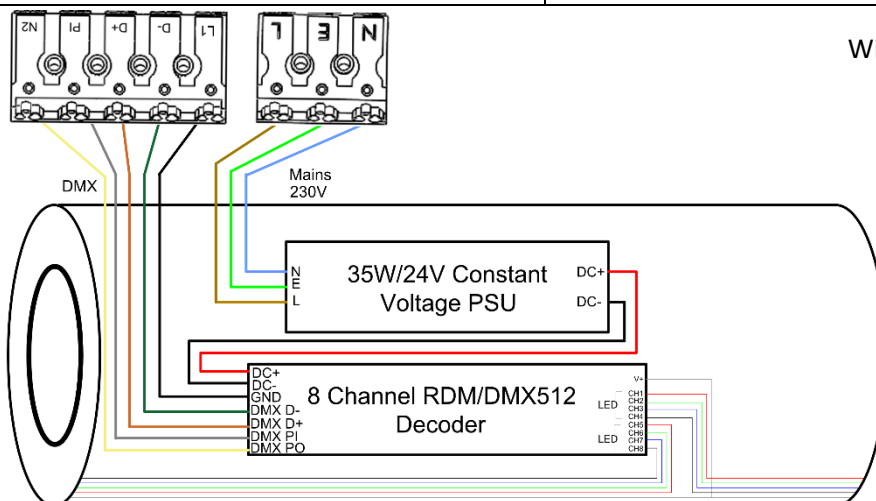


Wire Flexes into terminals.

6.

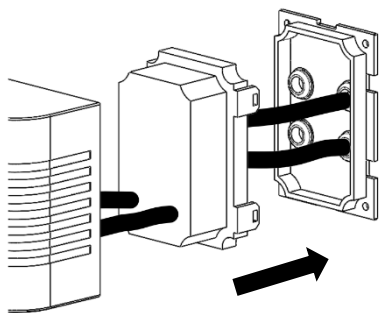


Reconnect the gear enclosure to the mounting plate.

7.

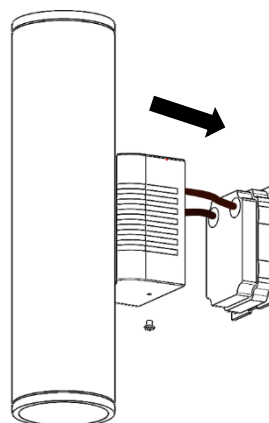

Mount the body onto the mounting plate.

8.

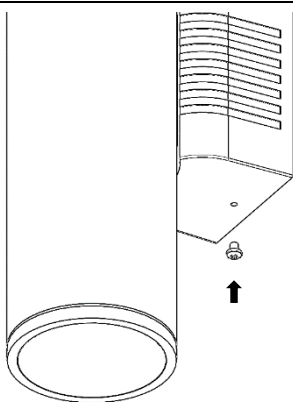

Inset screws to both top and bottom screw holes to secure body onto mounting plate.

9.

Reconnect supply and test