

220-240V / 50-60Hz
IP69k IK10

Terminal Labelling:


Power
L1 ⚡ Switched Live
E ⚡ Earth
N ⚡ Neutral



WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.


No user serviceable parts, do not open or attempt repair

1.

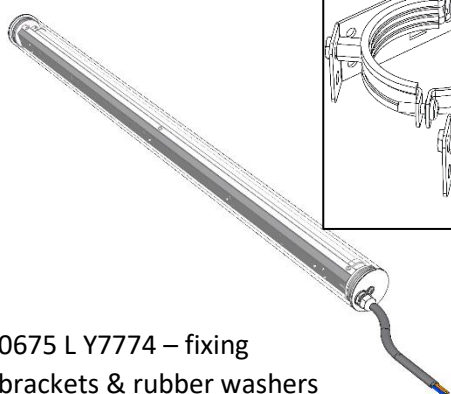


0675 L Y7774 – fixing brackets & rubber washers supplied as shown

2.

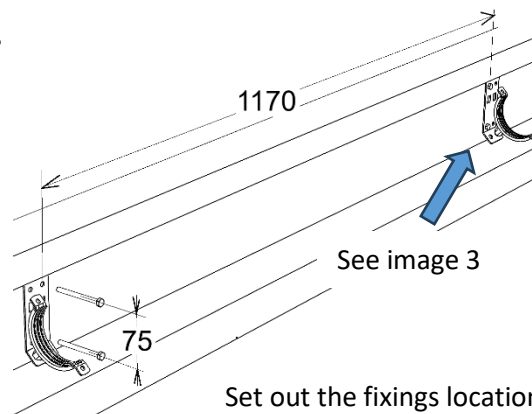


Set out the fixings locations – drill suitable holes as shown – Note pipe clamps orientation!

3.

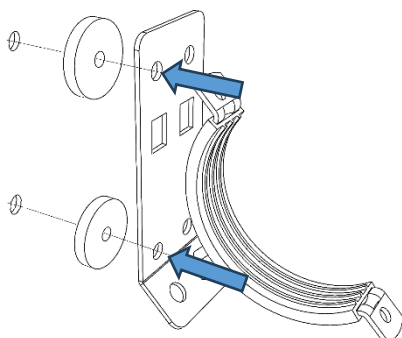


Note, rubber washers must be fitted as shown to ensure IK10 rating is maintained – use appropriate fixing bolts (not supplied) in holes shown

4.

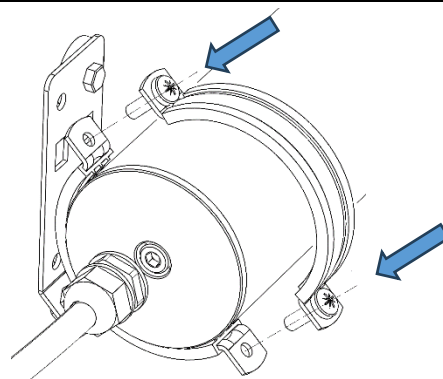


Rest PTB on to lower half of pipe-clamp – ensure its centred over length on the mounting brackets – secure in place using upper half of pipe clamp

5.

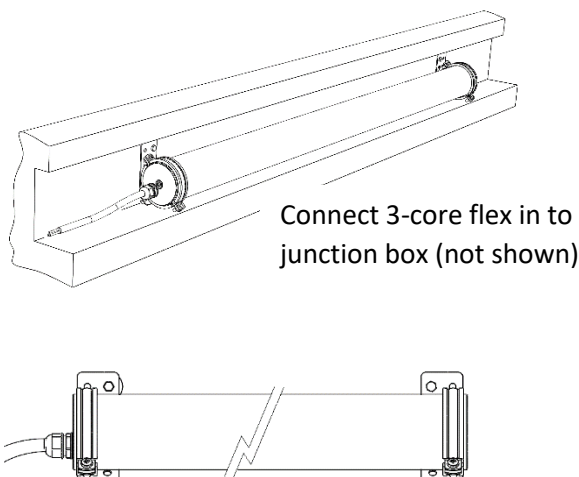

Connect 3-core flex in to junction box (not shown)

6.

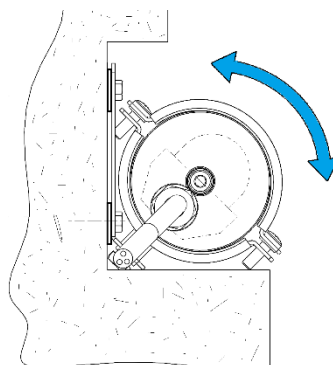

End view once installed – BE SURE TO CHECK ROTATIONAL ORIENTATION – adjust as necessary